


* MODIFIED PER ADA REQUIREMENTS


X*	Y*	Z*	CT
CURB HEIGHT	RAMP LENGTH	SIDE SLOPE	CURB TRANSITION
6	5'-6"	4'-7"	0'-0"
7	6'-6"	5'-5"	1'-0"
8	7'-6"	6'-3"	2'-0"

CONSTRUCTION NOTES


1. SET FALSE HEADER FOR BACK OF RAMP AT CURB HEIGHT ABOVE GRADE TO MAXIMUM 6".
2. WHERE SHOWN ON PLANS, CONSTRUCT MONOLITHIC CURB FOR RETENTION OF STREET DRAINAGE OR TO MEET ADJACENT IMPROVEMENTS.
3. SIDE SLOPE SHALL BE INCREASED TO A 12:1 SLOPE IF A 4' LANDING IS NOT PROVIDED.
4. THE REMOVAL OF EXISTING CONCRETE CURB, GUTTER, SIDEWALK AND PAVEMENT FOR PEDESTRIAN RAMP INSTALLATION SHALL COMPLY WITH SAN DIEGO REGIONAL STANDARD DRAWING G-11.

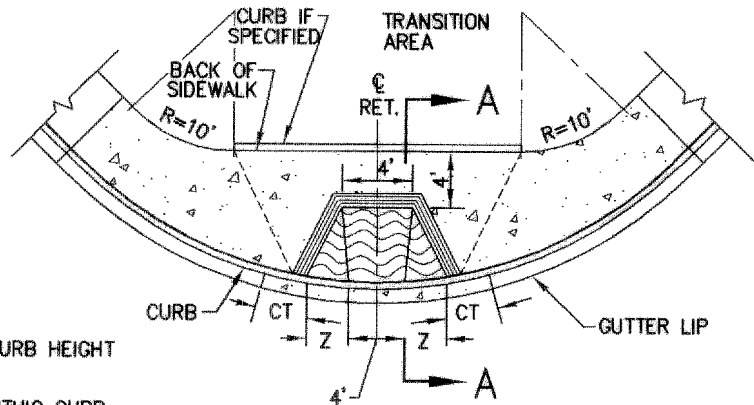

TYPE A

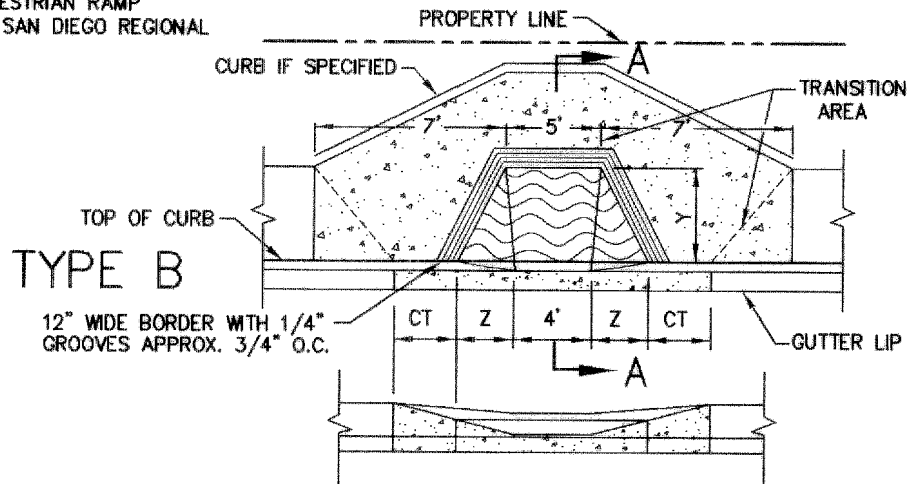

TYPE B

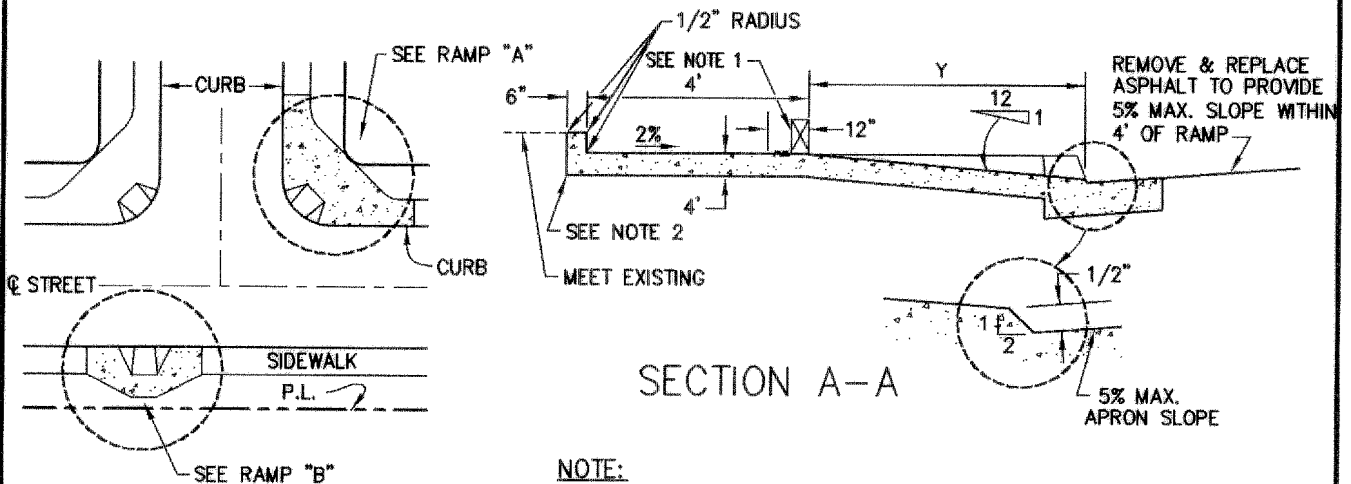

SECTION A-A

NOTE:

SEE CVCS-29 FOR GENERAL NOTES.

NOT TO SCALE

Revised:	Original approval date: 3-23-94	CITY OF CHULA VISTA PUBLIC WORKS DEPARTMENT	
	Redrawn By: CVM Date: 8-20-01		
	<i>Clifford Shannon</i>	PEDESTRIAN RAMP DETAIL TYPES "A" AND "B" MODIFIED (NEW CONSTRUCTION)	CVCS 25
	CITY ENGINEER Date: 11-7-02		